


## Alarm Reset Software Trimod-BUR

The software is composed by two files which must be copied together in the same folder.


The files are: Trimod\_BUR.exe and UpsCommLib.dll

The PC must be connected to the UPS trough 9 pin cable pin to pin (serial RS232) to the maintenance com in front of the UPS. (For Archimod is the one in the top command tunnel)

Launching the file the first screen is just for information:

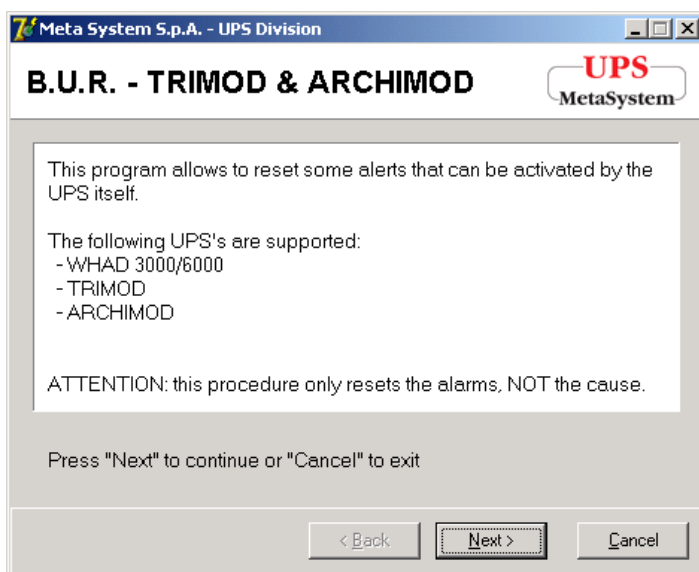

In the second screen the COM port of the computer must be selected:

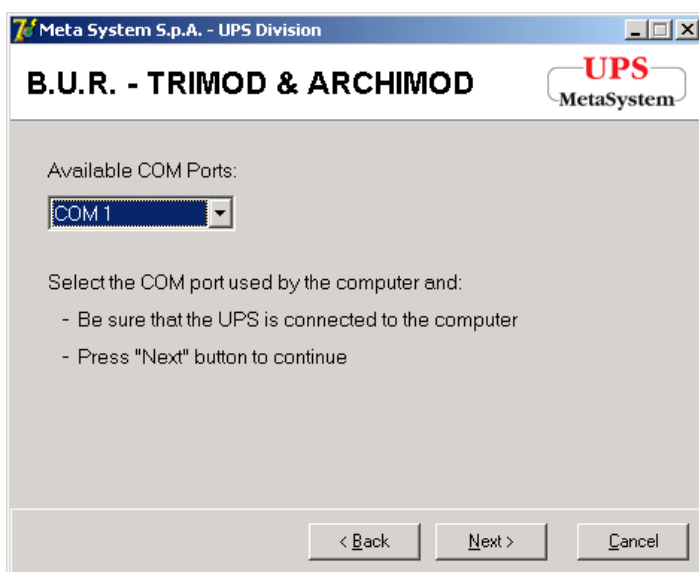

In the third screen are show the actual status of the alarms and the reset button. Con segnalazione attiva (status ON) sarà abilitato il pulsante di reset.

After the reset of the alarm, clicking “finish” will close the program.

Meta System S.p.A. - UPS Division

**B.U.R. - TRIMOD & ARCHIMOD**

**UPS**  
MetaSystem

**Informations about UPS**

Model name: TRIMOD 20 kVA  
Firmware version: 1.5.6  
Serial number: 000000000000

**'Make Maintenance' Alarm**

Function: Enabled  
Status: OFF  
Reset

**'Check Batteries' Alarm**

Function: Enabled  
Status: OFF  
Reset

< Back   Finish   Cancel